


Compact motion sensors Special outdoor version Surface/wall mounting - PIR

Catalogue number(s): 0 489 43/46

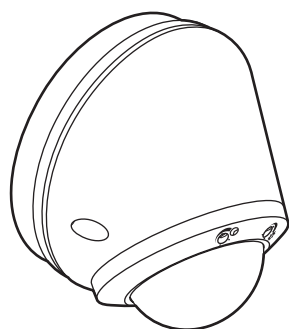

IP55

CONTENTS

Page

| | |
|-----------------------------------|---|
| 1. Use | 1 |
| 2. Technical features | 1 |
| 3. Overall dimensions | 2 |
| 4. Connection | 2 |
| 5. Dismantling | 3 |
| 6. Installation | 4 |
| 7. Settings | 4 |
| 8. Performance | 4 |
| 9. Maintenance | 4 |
| 10. Standards and approvals | 4 |

1. USE

This device, which is particularly suitable for outdoor areas, enables a light source to be controlled automatically by detecting movement in the monitoring area.

Using infrared (IR) technology, this IP55 motion sensor has a 360° detection angle and, when positioned 2.50 m above the ground, an 8 m x 8 m detection area.

It can be installed in ceilings or surface-mounted on walls.

It is quick and easy to set, using potentiometers.

The light level threshold can vary from 10 to 1275 lux and the time delay from 10 seconds to 10 minutes.

2. TECHNICAL FEATURES

Voltage: 240 V~

Frequency: 50/60 Hz

Consumption on standby: 0.75 W

Output via normally open contact connected to the phase

Wiring: 1 x 2.5 mm²/2 x 1.5 mm²

Number of terminals: 3

Type of terminal: screw

Drilling diameter for installation with flush-mounting box: 67 mm

Weight: 121 g


Impact resistance: IK04









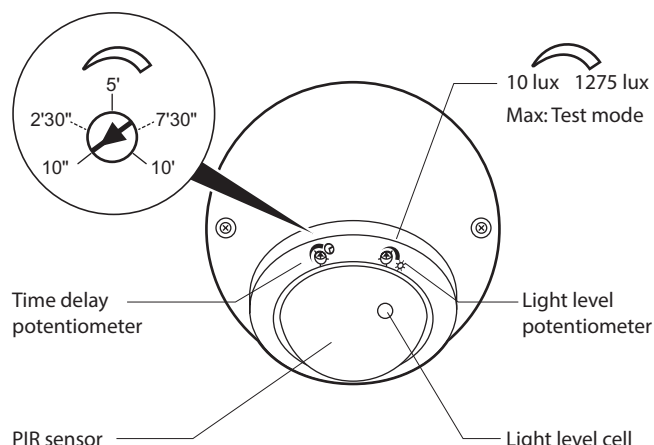

Penetration by solid and liquid matter: IP55











Usage temperature: -20°C to +45°C

Storage temperature: -20°C to +70°C

2. TECHNICAL FEATURES (continued)




| | | | | | | | | | | | | | | | |
|--------|---|---|-------|---|---|-------|---|---|-------|---|---|-------|---|---|-------|
| | ① |  | | ② |  | | ③ |  | | ④ |  | | ⑤ |  | |
| | |  | | |  | | |  | | |  | | |  | |
| 230 V~ | | 1000 W | 4.3 A | | 500 VA | 2.1 A | | 5 x (2x36 W) | 2.1 A | | 250 VA | 1.1 A | | 500 VA | 2.1 A |

| | | | | | | | | | | | | | | | |
|--------|---|---|-------|---|---|-------|---|---|-------|---|---|-------|---|---|-------|
| | ⑥ |  | | ⑦ |  | | ⑧ |  | | ⑨ |  | | ⑩ |  | |
| | |  | | |  | | |  | | |  | | |  | |
| 230 V~ | | 5 x (2x36 W) | 2.1 A | | 250 W | 1.1 A | | 250 VA | 1.1 A | | 250 VA | 1.1 A | | 250 W | 1.1 A |


- 1 - Halogen bulbs
- 2 - ELV halogen bulbs with separate ferromagnetic ballast
- 3 - Fluorescent tubes with separate ferromagnetic ballast
- 4 - Compact fluorescent bulbs with separate ferromagnetic ballast
- 5 - ELV halogen bulbs with separate electronic ballast
- 6 - Fluorescent tubes with separate electronic ballast
- 7 - Compact fluorescent bulbs with built-in electronic ballast
- 8 - Compact fluorescent bulbs with separate electronic ballast
- 9 - LED bulbs with separate electronic ballast
- 10 - LED bulbs with built-in electronic ballast

3. OVERALL DIMENSIONS

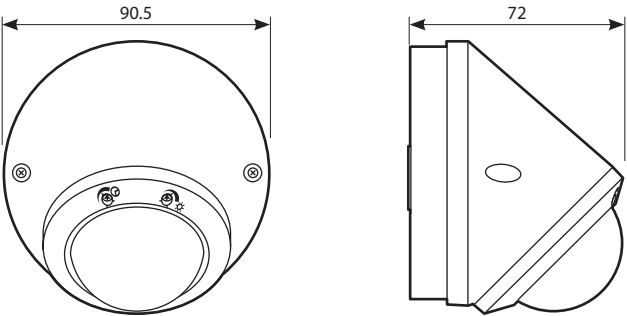


4. CONNECTION


■ 4.1 Wiring without auxiliary control:

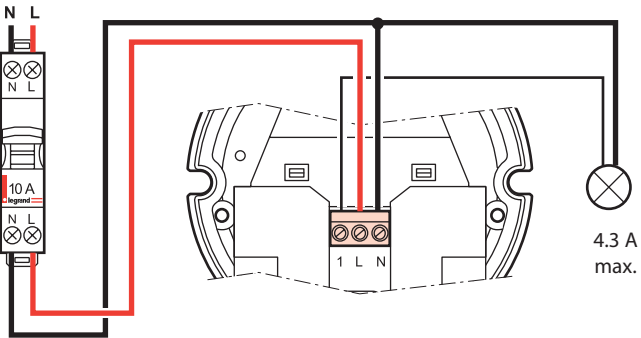

■ 4.2 Wiring for a single load connected in parallel

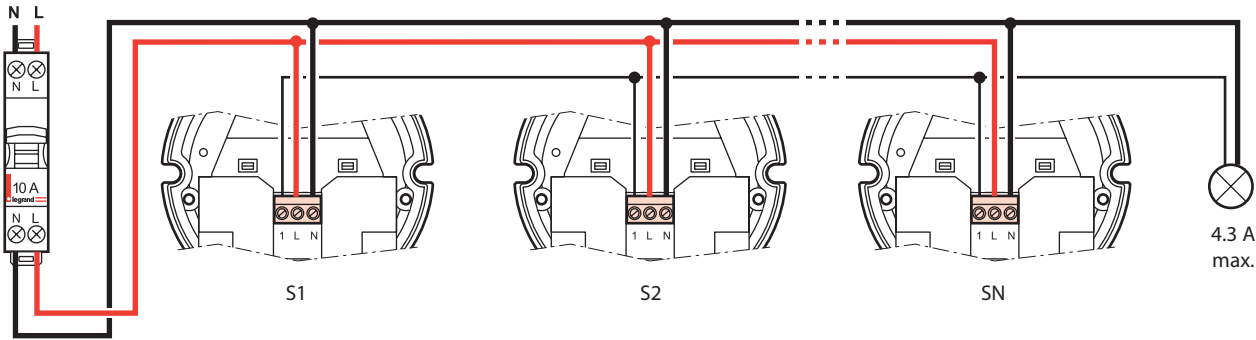


5. DISMANTLING

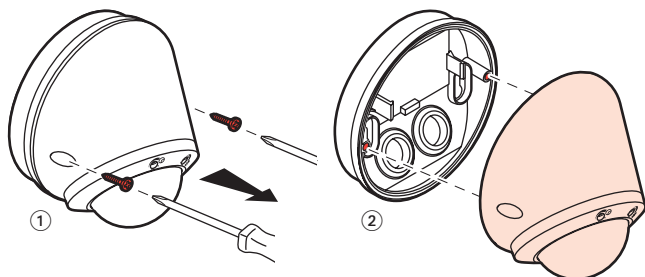



6. INSTALLATION

6.1 Positioning the sensor

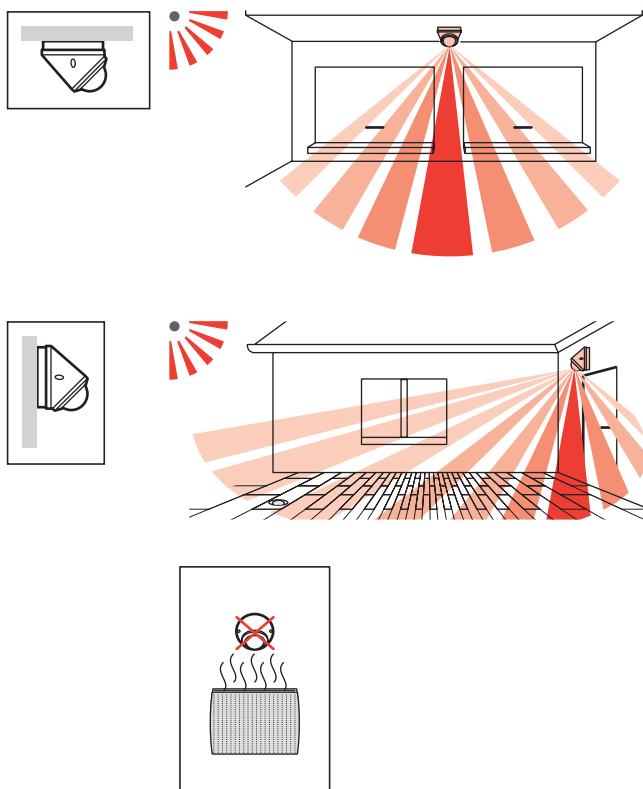





6. INSTALLATION (continued)

6.2 Positioning





Attention:

When mounting in ceilings,
break the tabs to allow water
to drain out.

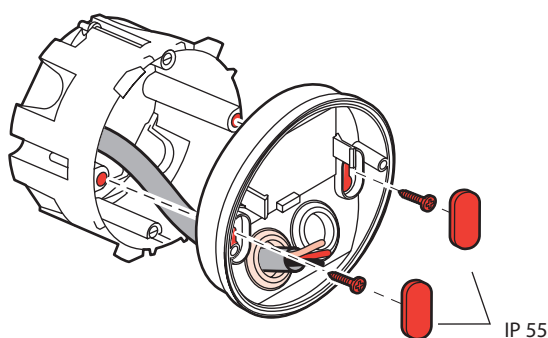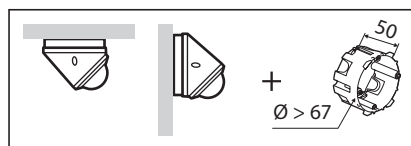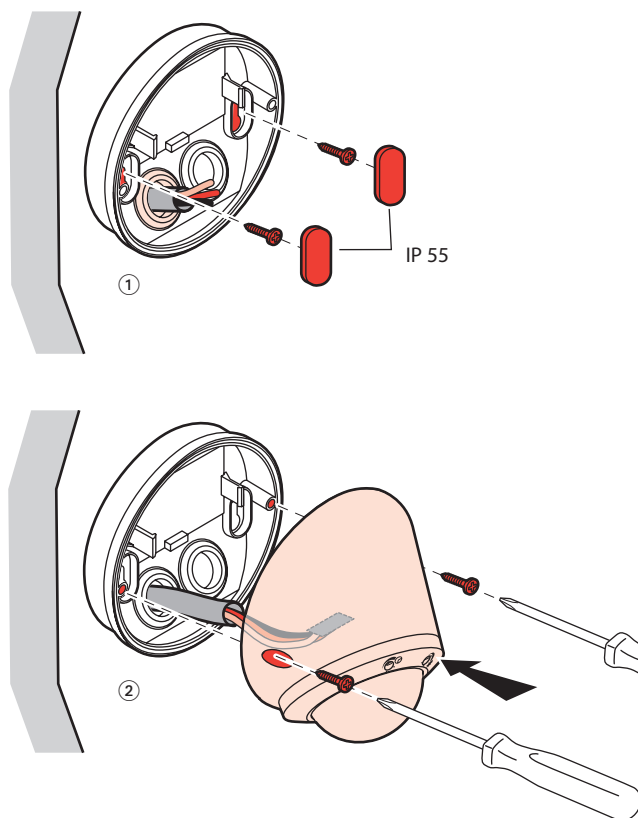

6. INSTALLATION (continued)

■ 6.2 Positioning (continued)

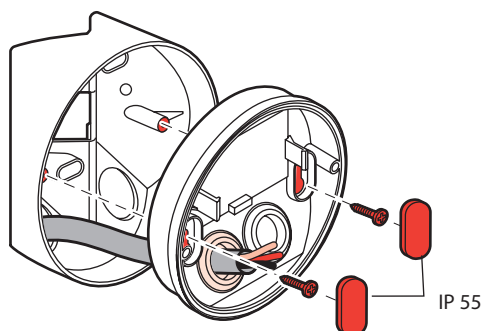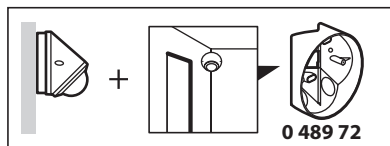

7. SETTING

■ 7.1 Time delay parameter

| Sensor parameter | Default value | Modifiable parameters |
|------------------|---------------|-----------------------|
| Time delay | Min. | 10 sec to 10 min |

⌚ **Time delay:** Length of time the load remains on after detection.

■ 7.2 Light level parameter

| Sensor parameter | Default value | Modifiable parameters |
|-----------------------|---------------|-----------------------|
| Light level threshold | Max. | 10 to 1275 lux |

☀ **Light level threshold:** Value at which the load switches on if the natural light level is below the setting.

■ 7.3 Detection

Automatic switch-on:

- On detection of presence, if there is an insufficient natural light level.



Automatic switch-off:

- If no presence is detected and at the end of the set time delay.

Any new detection triggers automatic switch-on if there is insufficient light.



8. PERFORMANCE

■ 8.1 Radial movement



8. PERFORMANCE (continued)

■ 8.2 Tangential movement

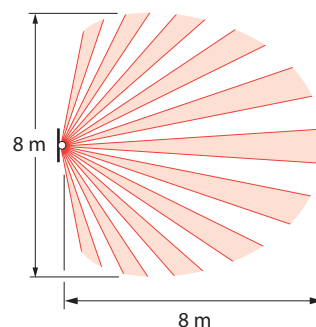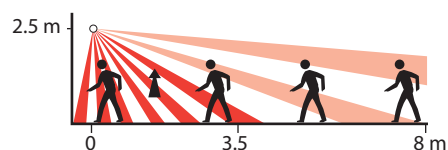

9. MAINTENANCE

Keep the lens clean.

Clean the surface with a cloth.

Do not use: acetone, tar-removing cleaning agents or trichloroethylene.

Maintenance with the following products: - Hexane (En 60669-1)

- Methylated spirit

- Soapy water

- Diluted ammonia

- Bleach diluted to 10%

- Window cleaning products

Attention:

Always test before using other special cleaning products.

10. STANDARDS

Directive: CE

Installation standards: NFC 15-100

Product standards: IEC 60669-2-1

Environmental standards:

- EU Directive 2002/96/EC:

WEEE (Waste Electrical and Electronic Equipment)

- EU Directive 2002/95/EC:

RoHS (Restriction of Hazardous Substances)

- Decrees and/or regulations: ERP (public buildings)

ERT (workplace buildings)

IGH (high-rise buildings)

Note:

All technical information is available at



www.legrandoc.com